



SELMA - KINGSBURG - FOWLER COUNTY SANITATION DISTRICT

DIRECTORS

Buddy Mendes, Chairman
Amarjeet Gill, Vice Chair
Jim Avalos
Nathan Magsig
Laura North

STAFF

Veronica Cazares, Gen. Mgr.

AUGUST 7, 2026

REQUEST FOR QUOTATIONS:

18TH AVENUE SEWER CLEANING AND CCTV INSPECTION

INTRODUCTION

The Selma-Kingsburg-Fowler County Sanitation District (District) is requesting quotations for sewer main and manhole cleaning and closed-circuit television inspection services (18th Avenue Sewer Cleaning and CCTV Inspection) to determine the conditions and characteristics of the existing sanitary sewer main. The services required generally consist of pipeline cleaning by jetting and video inspection of 7,736 linear feet of sewer main and 18 sewer manholes along 18th Avenue spanning from Kern Street to Kamm Avenue within the City of Kingsburg. The sewer main diameters consist of 24-inch, 21-inch and 10-inch pipe.

SUBMISSION OF QUOTES

All quotes shall be made in accordance with this RFQ, including any addenda and the attachments, a part of the quote documents, such documents being the only valid quote form when submitted with all pages intact and completed.

Quotes shall be submitted electronically in PDF format to Denise Isaguirre at disaguirre@skfcsd.org no later than **Friday, August 21, 2026**. The subject line of the e-mail should state: "Quote for 18th Avenue Sewer Cleaning and CCTV Inspection". It is the responsibility of the bidder to ensure that the point of contact has received a complete proposal by the required deadline.

The District reserves the right to reject in whole or in part any or all quotes for any reason or for no reason and to determine which submittal is, in the District's sole judgment, the best and most responsive submittal to the District's needs. The District also reserves the right to waive any informalities in any submittal.

PREVAILING WAGE AND DIR REQUIREMENTS

This Contract is subject to California prevailing wage requirements. Contractor shall comply with all applicable provisions of the California Labor Code relating to public works and prevailing wages. Contractor shall be registered with the California Department of Industrial Relations (DIR) and provide a valid DIR Registration Number with quote.

REQUESTS FOR INFORMATION

Questions or requests for clarification regarding the RFQ must be submitted in writing to **Denise Isaguirre** at disaguirre@skfcsd.org by 4:30 p.m. on **Monday, August 17, 2026**. Answers will be responded to via addendum and shared with all prospective respondents as well as be posted online at the District's Projects website (<https://www.skfcsd.org/projects>). The District will require acknowledgment of any addenda issued to be included in the quote form.

SCOPE OF SERVICES

The selected bidder shall perform sewer main and manhole cleaning, closed-circuit television (CCTV) inspection for approximately 7,736 linear feet (LF) of gravity sewer mains, and non-entry inspection of 18

sewer manholes, see table below. Sewer mains and manholes shall be cleaned prior to performing inspections. Sewer main inspections shall be performed and coded in accordance with current National Association of Sewer Service Companies (NASSCO) Pipeline Assessment Certification Program (PACP) standards. Manhole inspections shall be performed and coded in accordance with NASSCO Manhole Assessment Certification Program (MACP) Level 1 standards. The contractor shall provide all videos, photographs, reports, logs, and database files in accordance with the Specifications.

Segment #	Upstream Manhole ID	Downstream Manhole ID	Pipe Diameter (in)	Pipe Length (LF)
1	7EH0-0500	7EH0-0400	10	18
2	7EH0-0400	7EH0-0300	10	657
3	7EH0-0300	7EH0-0250	10	169
4	7EH0-0250	7EH0-0200	10	491
5	7EH0-0200	7EH0-0100	10	660
6	7EH0-0100	7EO0-1300	10	661
7	7EO0-1300	7EO0-1200	21	572
8	7EO0-1200	7EO0-1100	21	583
9	7EO0-1100	7EO0-0900	21	341
10	7EO0-0900	7EO0-0800	21	599
11	7EO0-0800	7EO0-0700	21	535
12	7EO0-0700	7EO0-0600	21	455
13	7EO0-0600	7EO0-0500	21	199
14	7EO0-0500	7EO0-0400	24	630
15	7EO0-0400	7EO0-0300	24	596
16	7EO0-0300	7EO0-0200	24	112
17	7EO0-0200	7EO0-0100	24	458
Approximate Total Length of Pipe				7,736

ATTACHMENTS

The following attachments are incorporated as part of this Request for Quotations:

ATTACHMENT 1: SPECIFICATIONS

ATTACHMENT 2: SERVICE LOCATION MAP

ATTACHMENT 3: SKF SEWER PLAT MAPS

QUOTE

The Bidder acknowledges that the quote submitted shall include all costs necessary to complete the services described in the Request for Quotations and Specifications. The Contractor shall include in the price all labor, materials, equipment, transportation, disposal, permits, supervision, and incidental work required to complete the services, whether identified in an item or not. Quotes shall remain valid for sixty (60) calendar days following the quote submittal date.

Item #	Item	Unit	Quantity	Total Price
1	Mobilization/Demobilization (Maximum 5% of Total Quote)	LS	1	
2	Traffic Control Plan	LS	1	
3	Sewer Main and Manhole Cleaning	LS	1	
4	Sewer Main CCTV PACP Inspection and Manhole MACP Level 1 Inspection	LS	1	

18TH AVENUE SEWER CLEANING AND CCTV INSPECTION: total quotation items 1 through 4.

Total \$ _____ (in figures)

_____ Dollars
(in words)

Signature: _____

(Firm Name)

(Address, City, State)

Addenda Acknowledged: _____ of _____

California Contractor License No.: _____

DIR Registration No.: _____

The Contractor agrees to complete the specified services within **twenty (20) working days** following receipt of written authorization to proceed from the District.

Proposed Start Date: _____

Proposed Completion Date: _____

ATTACHMENT 1: SPECIFICATIONS

SELMA – KINGSBURG - FOWLER
COUNTY SANITATION DISTRICT

SPECIFICATIONS

FOR

18TH AVENUE SEWER CLEANING AND CCTV INSPECTION

MOBILIZATION/DEMObILIZATION: Mobilization and demobilization shall include all labor, equipment, materials, transportation, supervision, permits, notifications, and incidental work necessary to perform the work.

The Contractor shall obtain all permits, licenses and approvals required by agencies having jurisdiction, including the City of Kingsburg (City) and the California Department of Transportation (Caltrans), if applicable. The Contractor shall coordinate all work within the District and applicable agencies prior to commencing work.

Payment for Mobilization/Demobilization shall be made at the lump sum price and shall constitute full compensation for all labor, equipment, materials, mobilization, demobilization, permits, coordination, scheduling, and incidentals necessary to complete the work.

WORK SCHEDULE: The Contractor shall submit a proposed work schedule for review by the District within five (5) calendar days from receipt of written authorization to proceed by the District. The schedule shall identify anticipated dates for mobilization, sewer cleaning and inspections, and submittal of final deliverables.

Normal working hours shall be Monday through Friday, 7:00 a.m. to 3:30 p.m., excluding holidays. Work outside these hours, on weekends, or on holidays, shall require prior written approval from the District.

Sewer cleaning and inspections may be required during low-flow periods to minimize system disruptions and maximize observable pipe-cross sections.

TRAFFIC CONTROL PLAN: The Contractor shall prepare and implement a Traffic Control Plan (TCP). The Contractor shall furnish all labor, equipment, materials, and supervision necessary to safely perform the work.

The TCP shall comply with the latest edition of the California Manual on Uniform Traffic Control Devices (CA MUTCD) and all requirements of agencies having jurisdiction. The TCP shall be submitted to and approved by all agencies and the District. No work shall begin until the TCP is approved in writing and submitted to the District at least two (2) working days before the start of any work.

Payment for Traffic Control Plan shall be made at the lump sum price and shall constitute full compensation for furnishing all labor, equipment, materials, permits, and incidentals necessary to complete the work.

SEWER MAIN AND MANHOLE CLEANING: High velocity cleaning equipment shall be used to flush and clean the sewer lines prior to inspections. The equipment must have a selection of two or more high-velocity nozzles with a minimum capacity of 30 gpm with a working pressure of 2,000 psi to 3,000 psi. The nozzles must produce a scouring action from 15 to 45 degrees in all sizes of pipelines designated to be cleaned. The equipment must have a minimum of 700 feet of high-pressure hose. Equipment must also include a high-velocity gun for washing and scouring manhole walls and floors. Precautions shall be taken to ensure water pressure does not damage or cause flooding of public or private property being served by the sewer.

Contractor shall thoroughly clean sewer mains and remove all sludge, grease, sediment, debris and other solids or semisolids as necessary to provide a clear and unobstructed view of the pipe interior.

All debris including, but not limited to, sludge, grease, sediment, roots and other solids or semisolids resulting from the cleaning operation shall be removed at the downstream manhole of the segment being cleaned. Passing materials to downstream sewer segments is not permitted. All solids and semisolids resulting from the cleaning shall be removed from the site and disposed of at the District's Wastewater Treatment Plant at Sludge Bed No. 24 located at 11301 E Conejo Avenue, Kingsburg. All materials shall be removed from the site by the end of each working day.

Sewage or solids shall not be dumped onto the ground surface, streets, in the sewer system, or other areas. In the event of any accidental discharge from cleaning operations, the Contractor shall immediately notify the District. The Contractor shall be responsible for all cleanup and the cost of all fines resulting from any spills or overflows.

Contractor shall furnish all water required for cleaning operations. Coordination for hydrant access shall be through the City's Public Works Department.

Payment for Sewer Main and Manhole Cleaning shall be made at the lump sum price and shall constitute full compensation for furnishing all labor, equipment, water, debris removal, disposal, supervision and incidentals necessary to complete the cleaning.

CLOSED CIRCUIT TELEVISION (CCTV) INSPECTION: Closed Circuit Television (CCTV) inspection shall be in color and shall be recorded in digital format on USB Thumb Drive, External Hard Drive, or an approved alternative, which shall become the property of the District.

Sewer video inspection requirements:

1. All CCTV work shall conform to current NASSCO-PACP standards.
2. The Contractor shall schedule a consultation meeting with the District prior to the commencement of CCTV to review requirements of the CCTV inspection, deliverables, and reporting procedures.
3. All coding and reporting shall be completed by personnel holding current NASSCO PACP certification. Proof of certification shall be submitted to the District prior to performing video inspections.
4. All PACP header information shall be completed in accordance with current NASSCO PACP Guidelines.
5. The Contractor shall use the District's sewer manhole identification system to indicate location of upstream and downstream sewer manholes.
6. The Contractor shall submit to District PACP CCTV Reports, PACP database files, logs, and electronic reports noting all observed defects and conditions.
7. The speed of travel shall be slow enough to inspect each pipe joint, tee connection, structural deterioration, infiltration and inflow sources, and deposits, but should not, at any time, be faster than 30 feet per minute.
8. The camera must be centered in the pipe to provide accurate distance measurements for locating features within the sewer and these footage measurements shall be continuously displayed and documented on the video.
9. The pipe should be clean enough to ensure all defects, features and observations are seen and logged.
10. The District Inspector will be provided at least 48-hour notice of cleaning and inspection schedule and will be present to monitor the services unless otherwise approved.

11. Jetting equipment shall remain available during CCTV inspection activities as necessary to aid in the video inspection.
12. A digital recording shall be submitted to the District as documentation of the completed inspection.
13. The CCTV camera, lighting system, and associated equipment shall be capable of operating in 100% humidity conditions. The lighting shall allow a clear picture of the entire periphery of the pipe. The video quality shall be to the satisfaction of the District; and if unsatisfactory, it may be rejected and the inspection shall be re-performed at no additional cost to the District.
14. Lateral lines to be identified and documented by stationing from center line of manhole.
15. A chronological log of the inspection shall correlate between the sewer plat maps, PACP reports, video recordings and the District's sewer manhole numbers.
16. Deliverables shall include:
 - a. Digital video files of all inspections
 - b. PACP Inspection reports
 - c. PACP Database files compatible with NASSCO-certified software
 - d. Inspection logs
 - e. Summary report identifying significant defects and observations.
 - f. Map identifying inspected sewer segments
17. No manhole entry shall be required or permitted as part of this work unless specifically authorized in writing by the District. All inspection activities shall be conducted from the surface utilizing remotely operated CCTV equipment and other non-entry methods.

Payment for CCTV Inspections shall be included in the lump sum price for Sewer Main CCTV PACP Inspection and Manhole MACP Level 1 Inspection and shall constitute full compensation for furnishing all CCTV inspection, PACP coding, reporting, digital videos, database files, logs, and incidentals necessary to complete the inspection.

MANHOLE INSPECTION: Manhole inspections shall conform to current NASSCO MACP Level 1 standards. All coding and reporting shall be completed by personnel holding current NASSCO MACP Level 1 certification.

Manhole inspection requirements:

1. All coding and reporting shall be completed by personnel holding current NASSCO MACP Level 1 certification. Proof of certification shall be submitted to the District prior to performing manhole inspections.
2. The Contractor shall use the District's sewer manhole identification system to identify each manhole.
3. Digital photographs or videos shall clearly show the frame and cover, chimney, barrel walls, bench, invert, and any observed defects.
4. No manhole entry shall be permitted unless specifically authorized in writing by the District.
5. Deliverables shall include:
 - a. MACP inspection reports
 - b. MACP database files compatible with NASSCO-certified software
 - c. Digital photos or videos of each manhole
 - d. Inspection logs
 - e. Summary report identifying significant defects and observations

Payment for manhole inspections shall be included in the lump sum price for Sewer Main CCTV PACP Inspection and Manhole MACP Level 1 Inspection and shall constitute full compensation for furnishing all MACP Level 1 inspection, coding, reporting, photographs or videos, database files, and incidentals necessary to complete the inspection.

SAFETY: The contractor shall comply with all federal, state, and local safety regulations and all applicable Cal-Osha requirements. The services are intended to be completed using non-entry inspection methods.

ATTACHMENT 2: SERVICE LOCATION MAP




ATTACHMENT 3: SKF SEWER PLAT MAPS


- SEWER GRID INDEX
- PLAT MAP K44
- PLAT MAP K45
- PLAT MAP K46
- PLAT MAP K47
- PLAT MAP K48

NOTE: LABELS TO PROPOSED SEWER MAIN AND MANHOLES TO BE CLEANED AND INSPECTED ARE IN RED




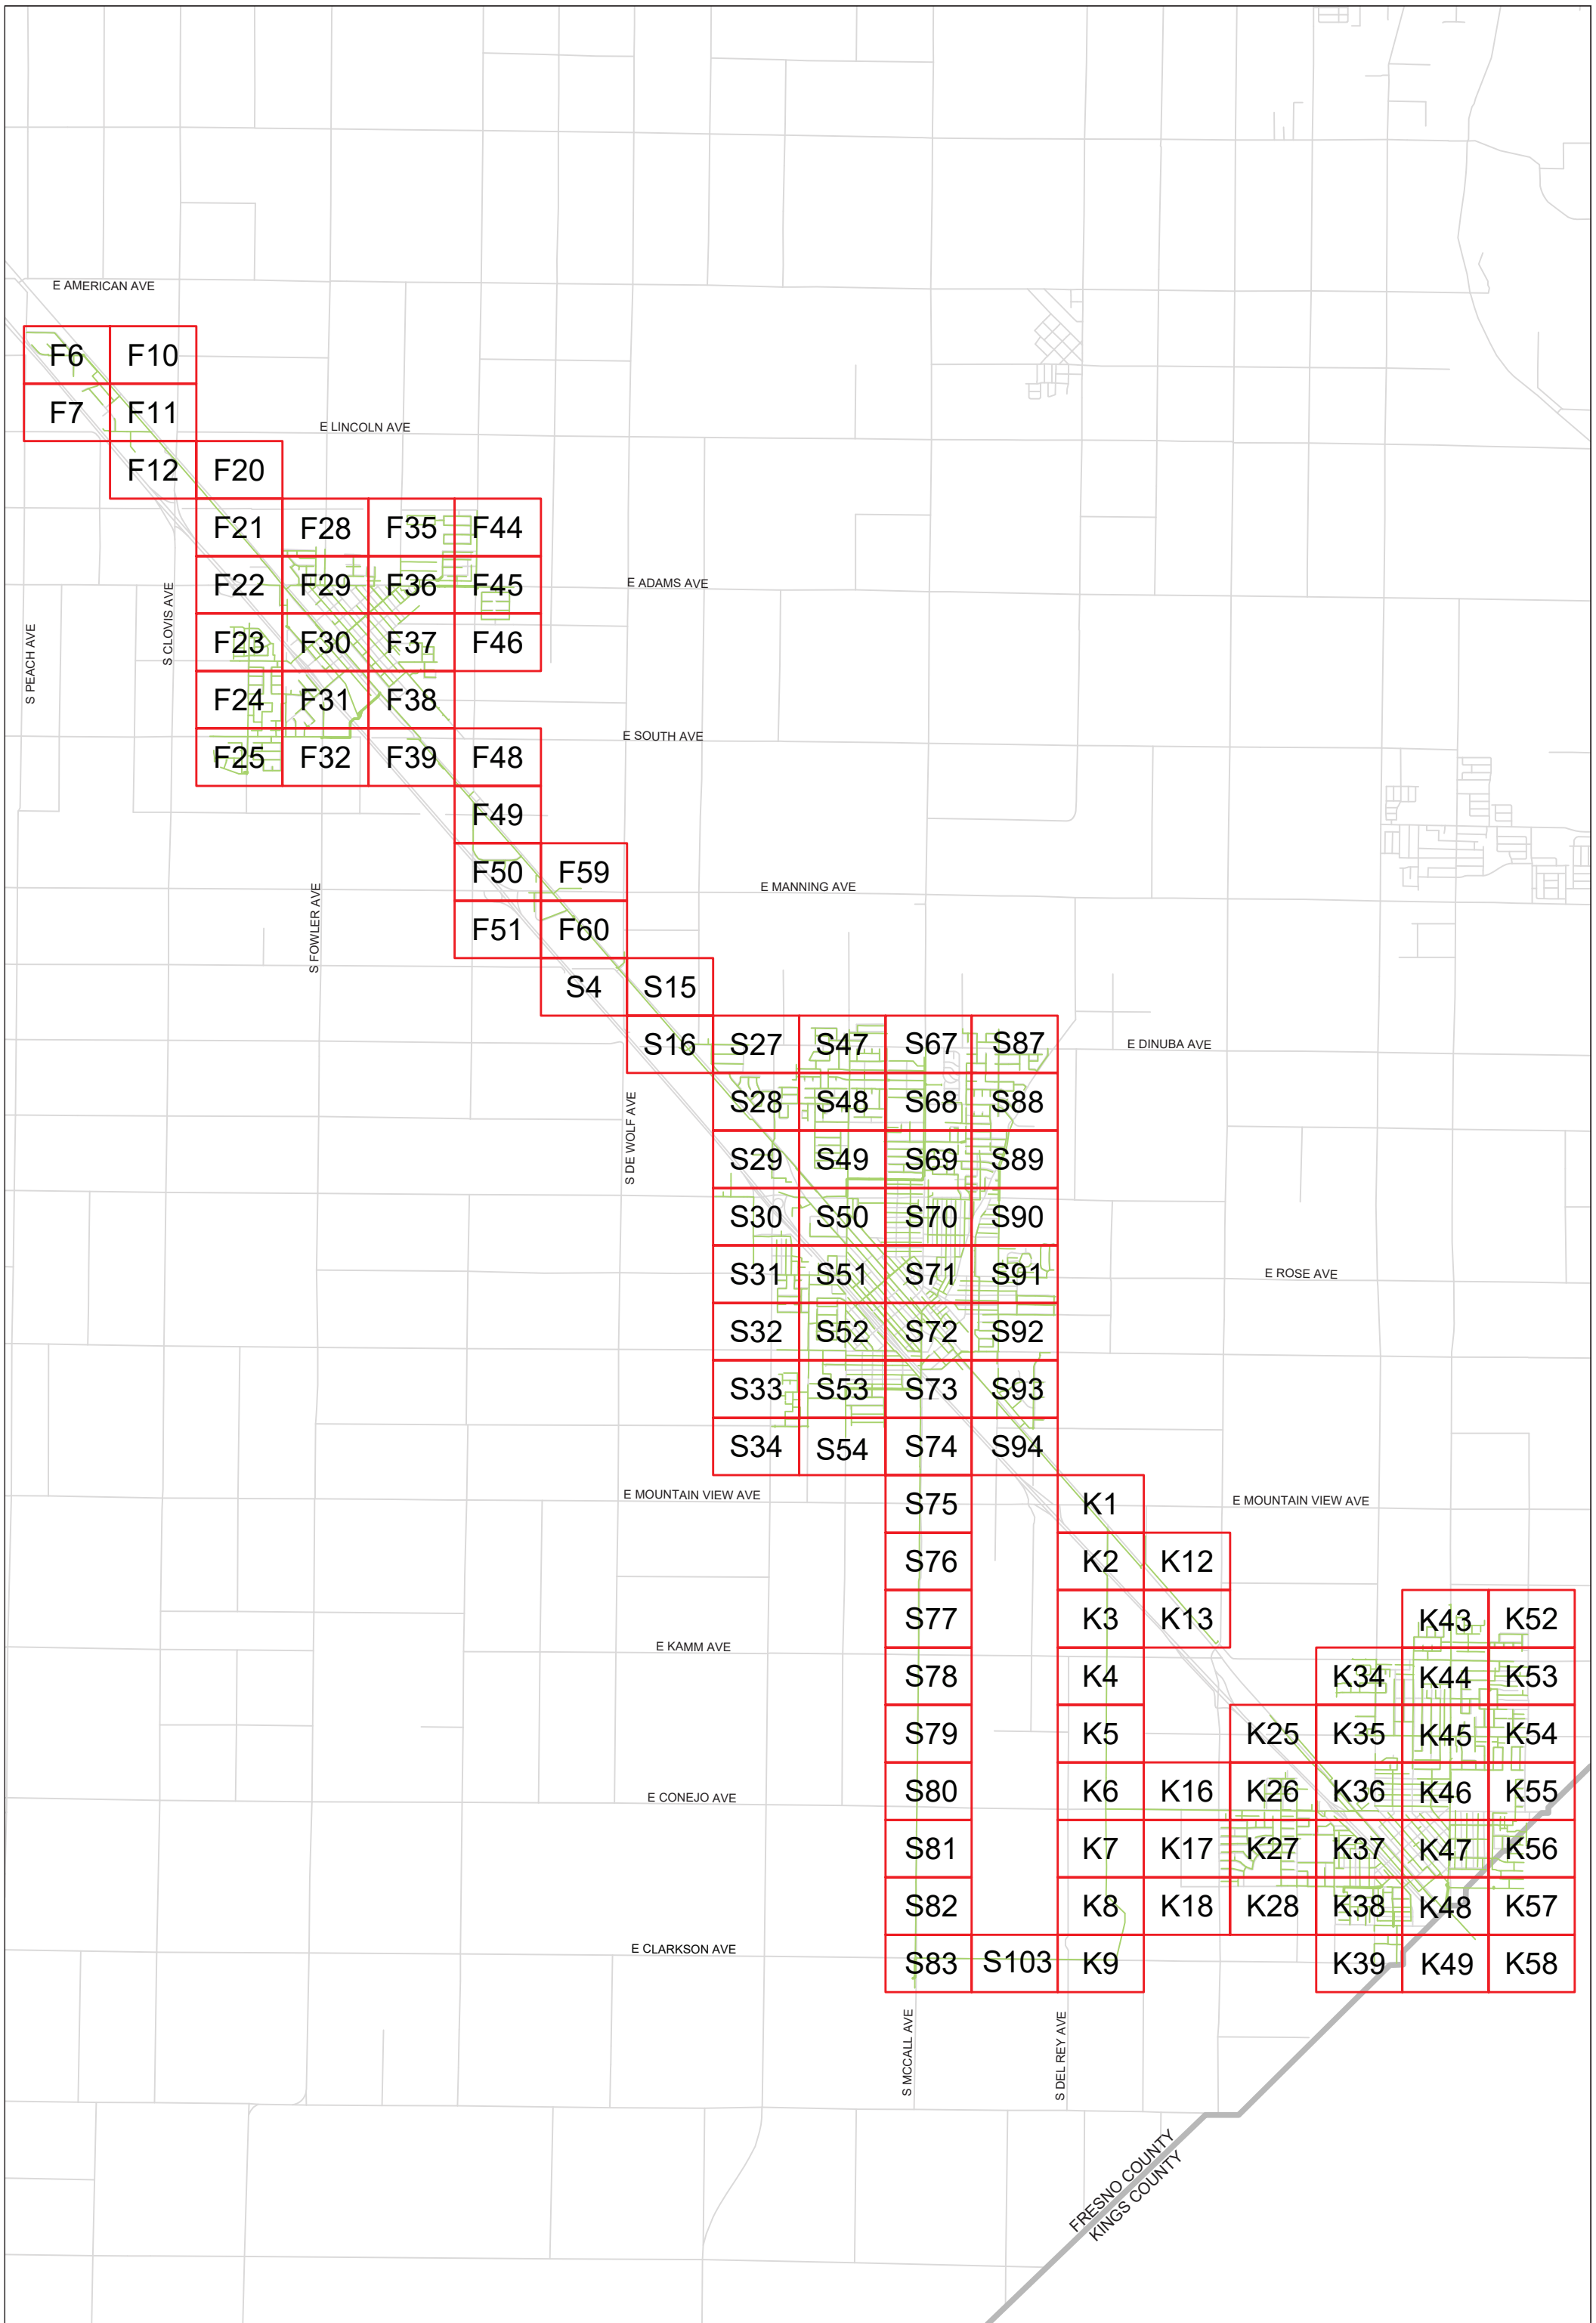







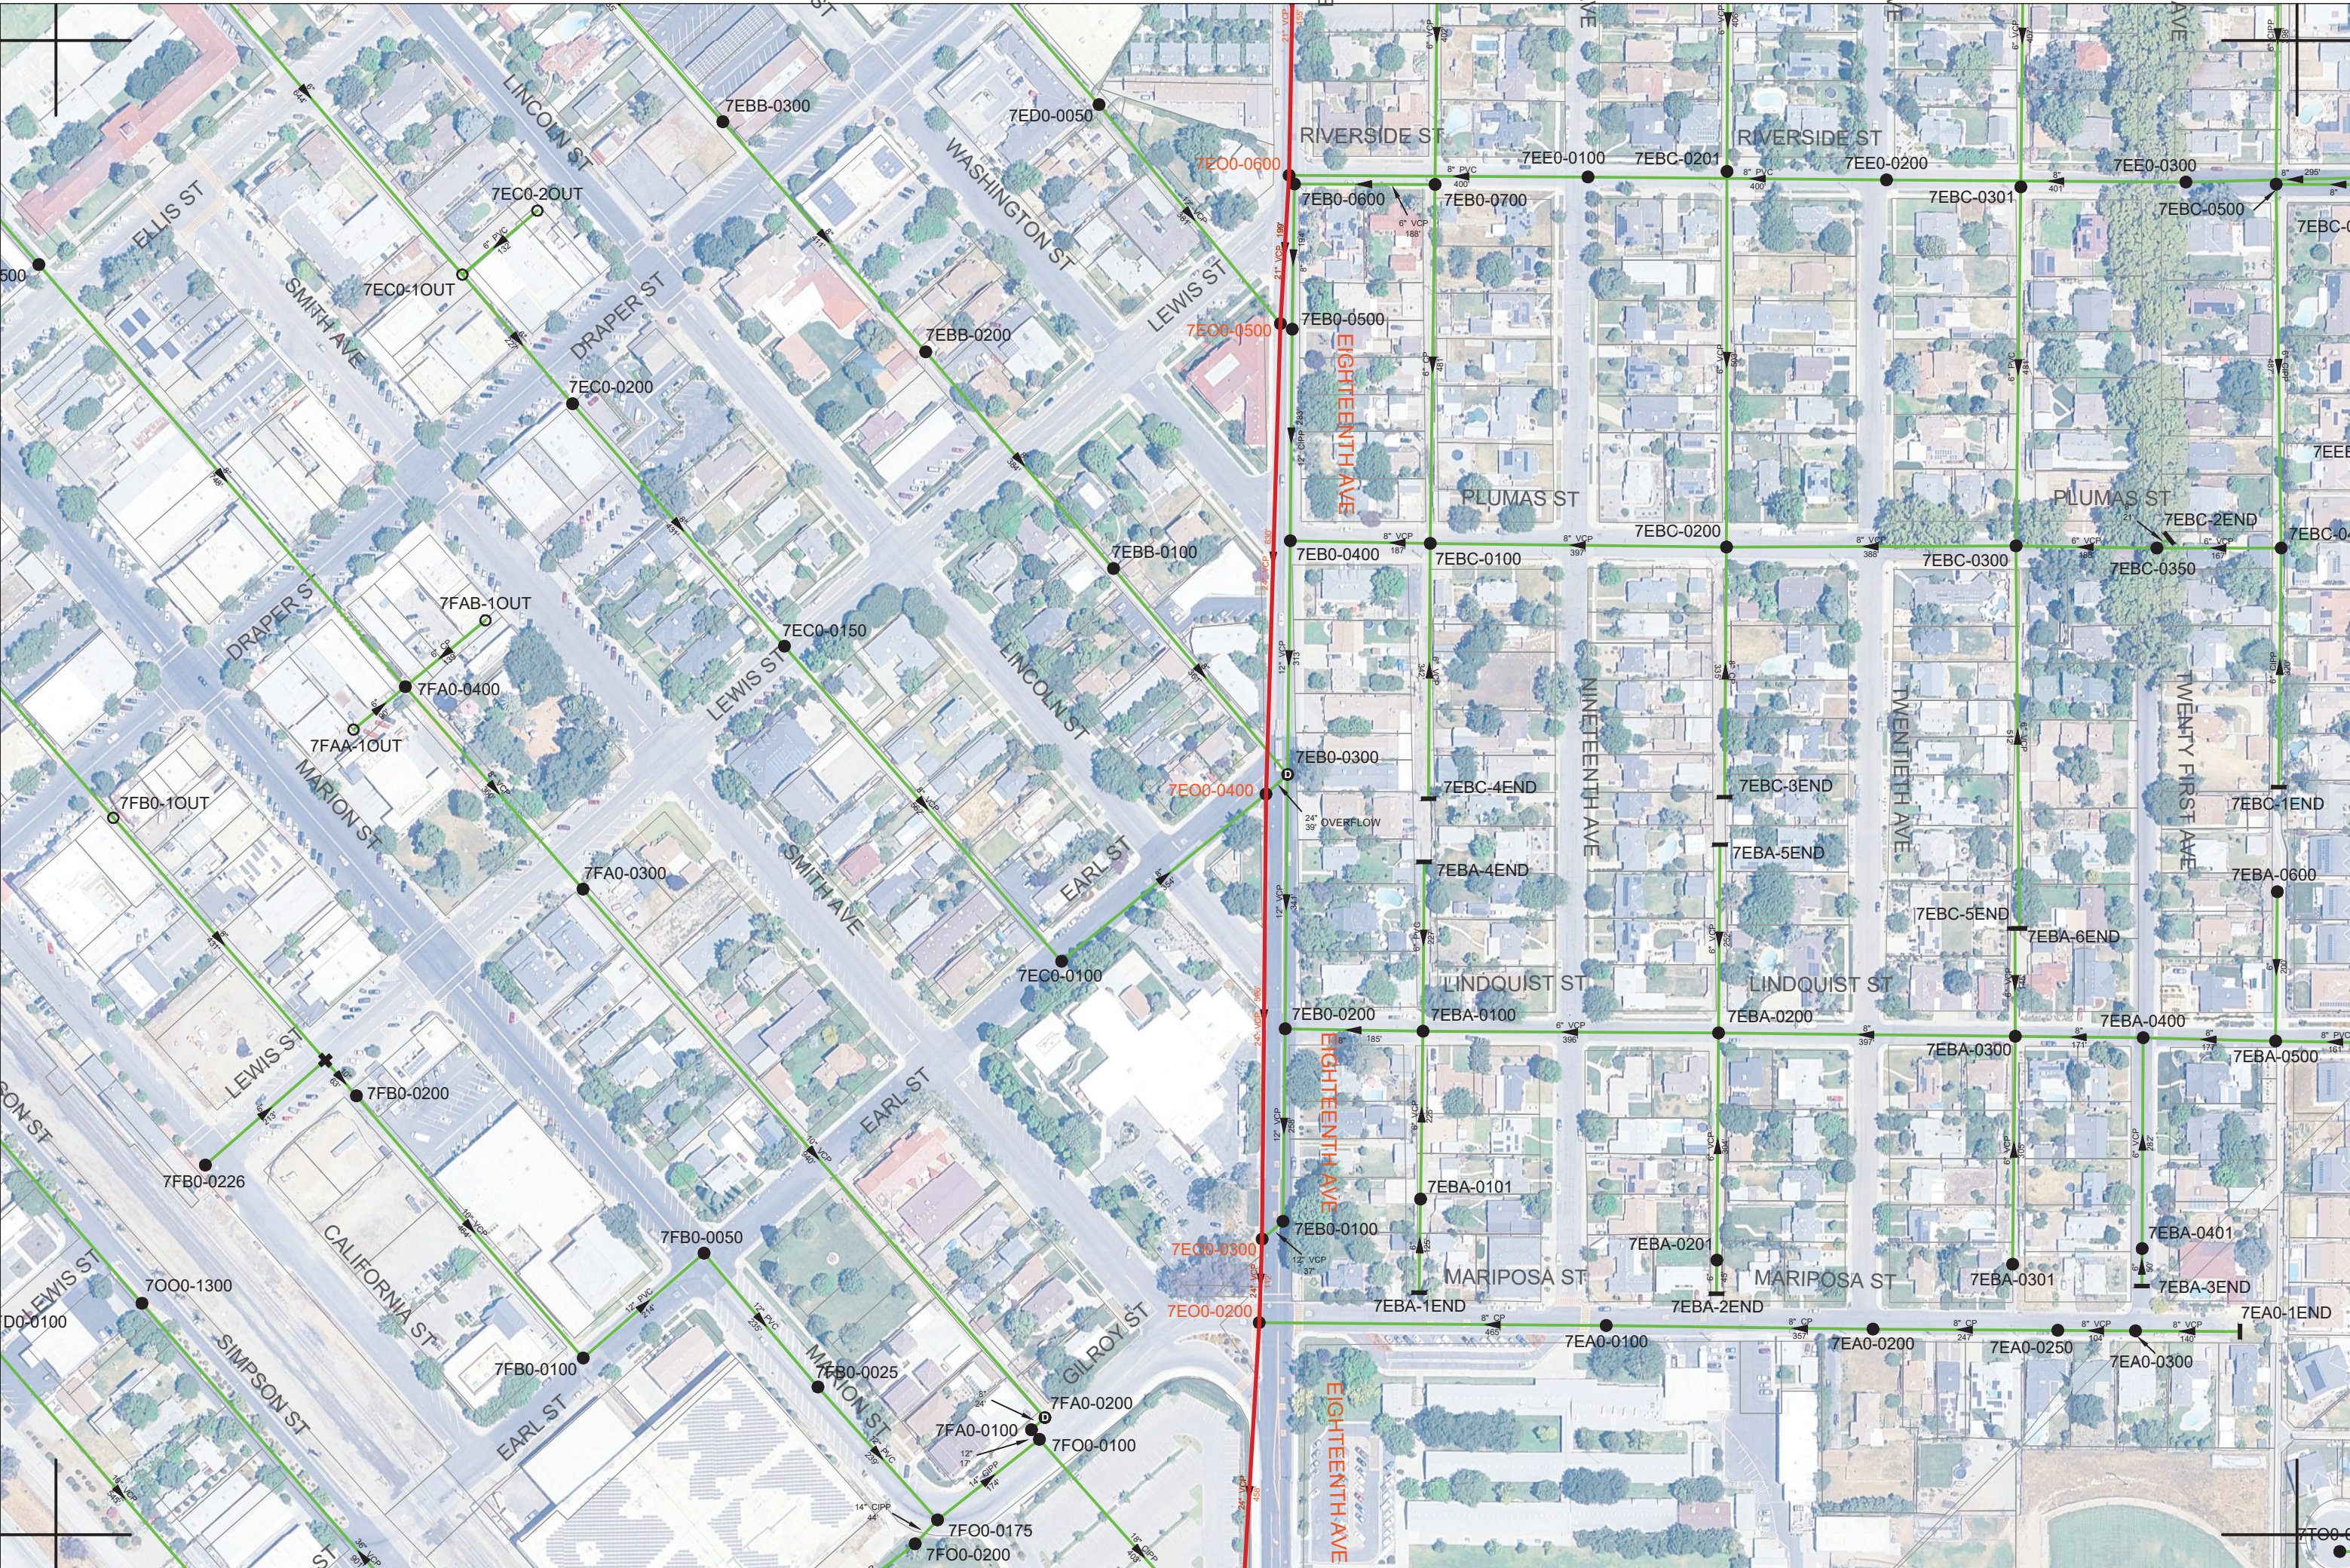


DATE PRINTED:
November 17, 2025

SELMA - KINGSBURG - FOWLER
COUNTY SANITATION DISTRICT

GRAPHIC SCALE
0 100 200 300 400
FEET

K36	K46	K55
K37	K47	K56
K38	K48	K57


K47

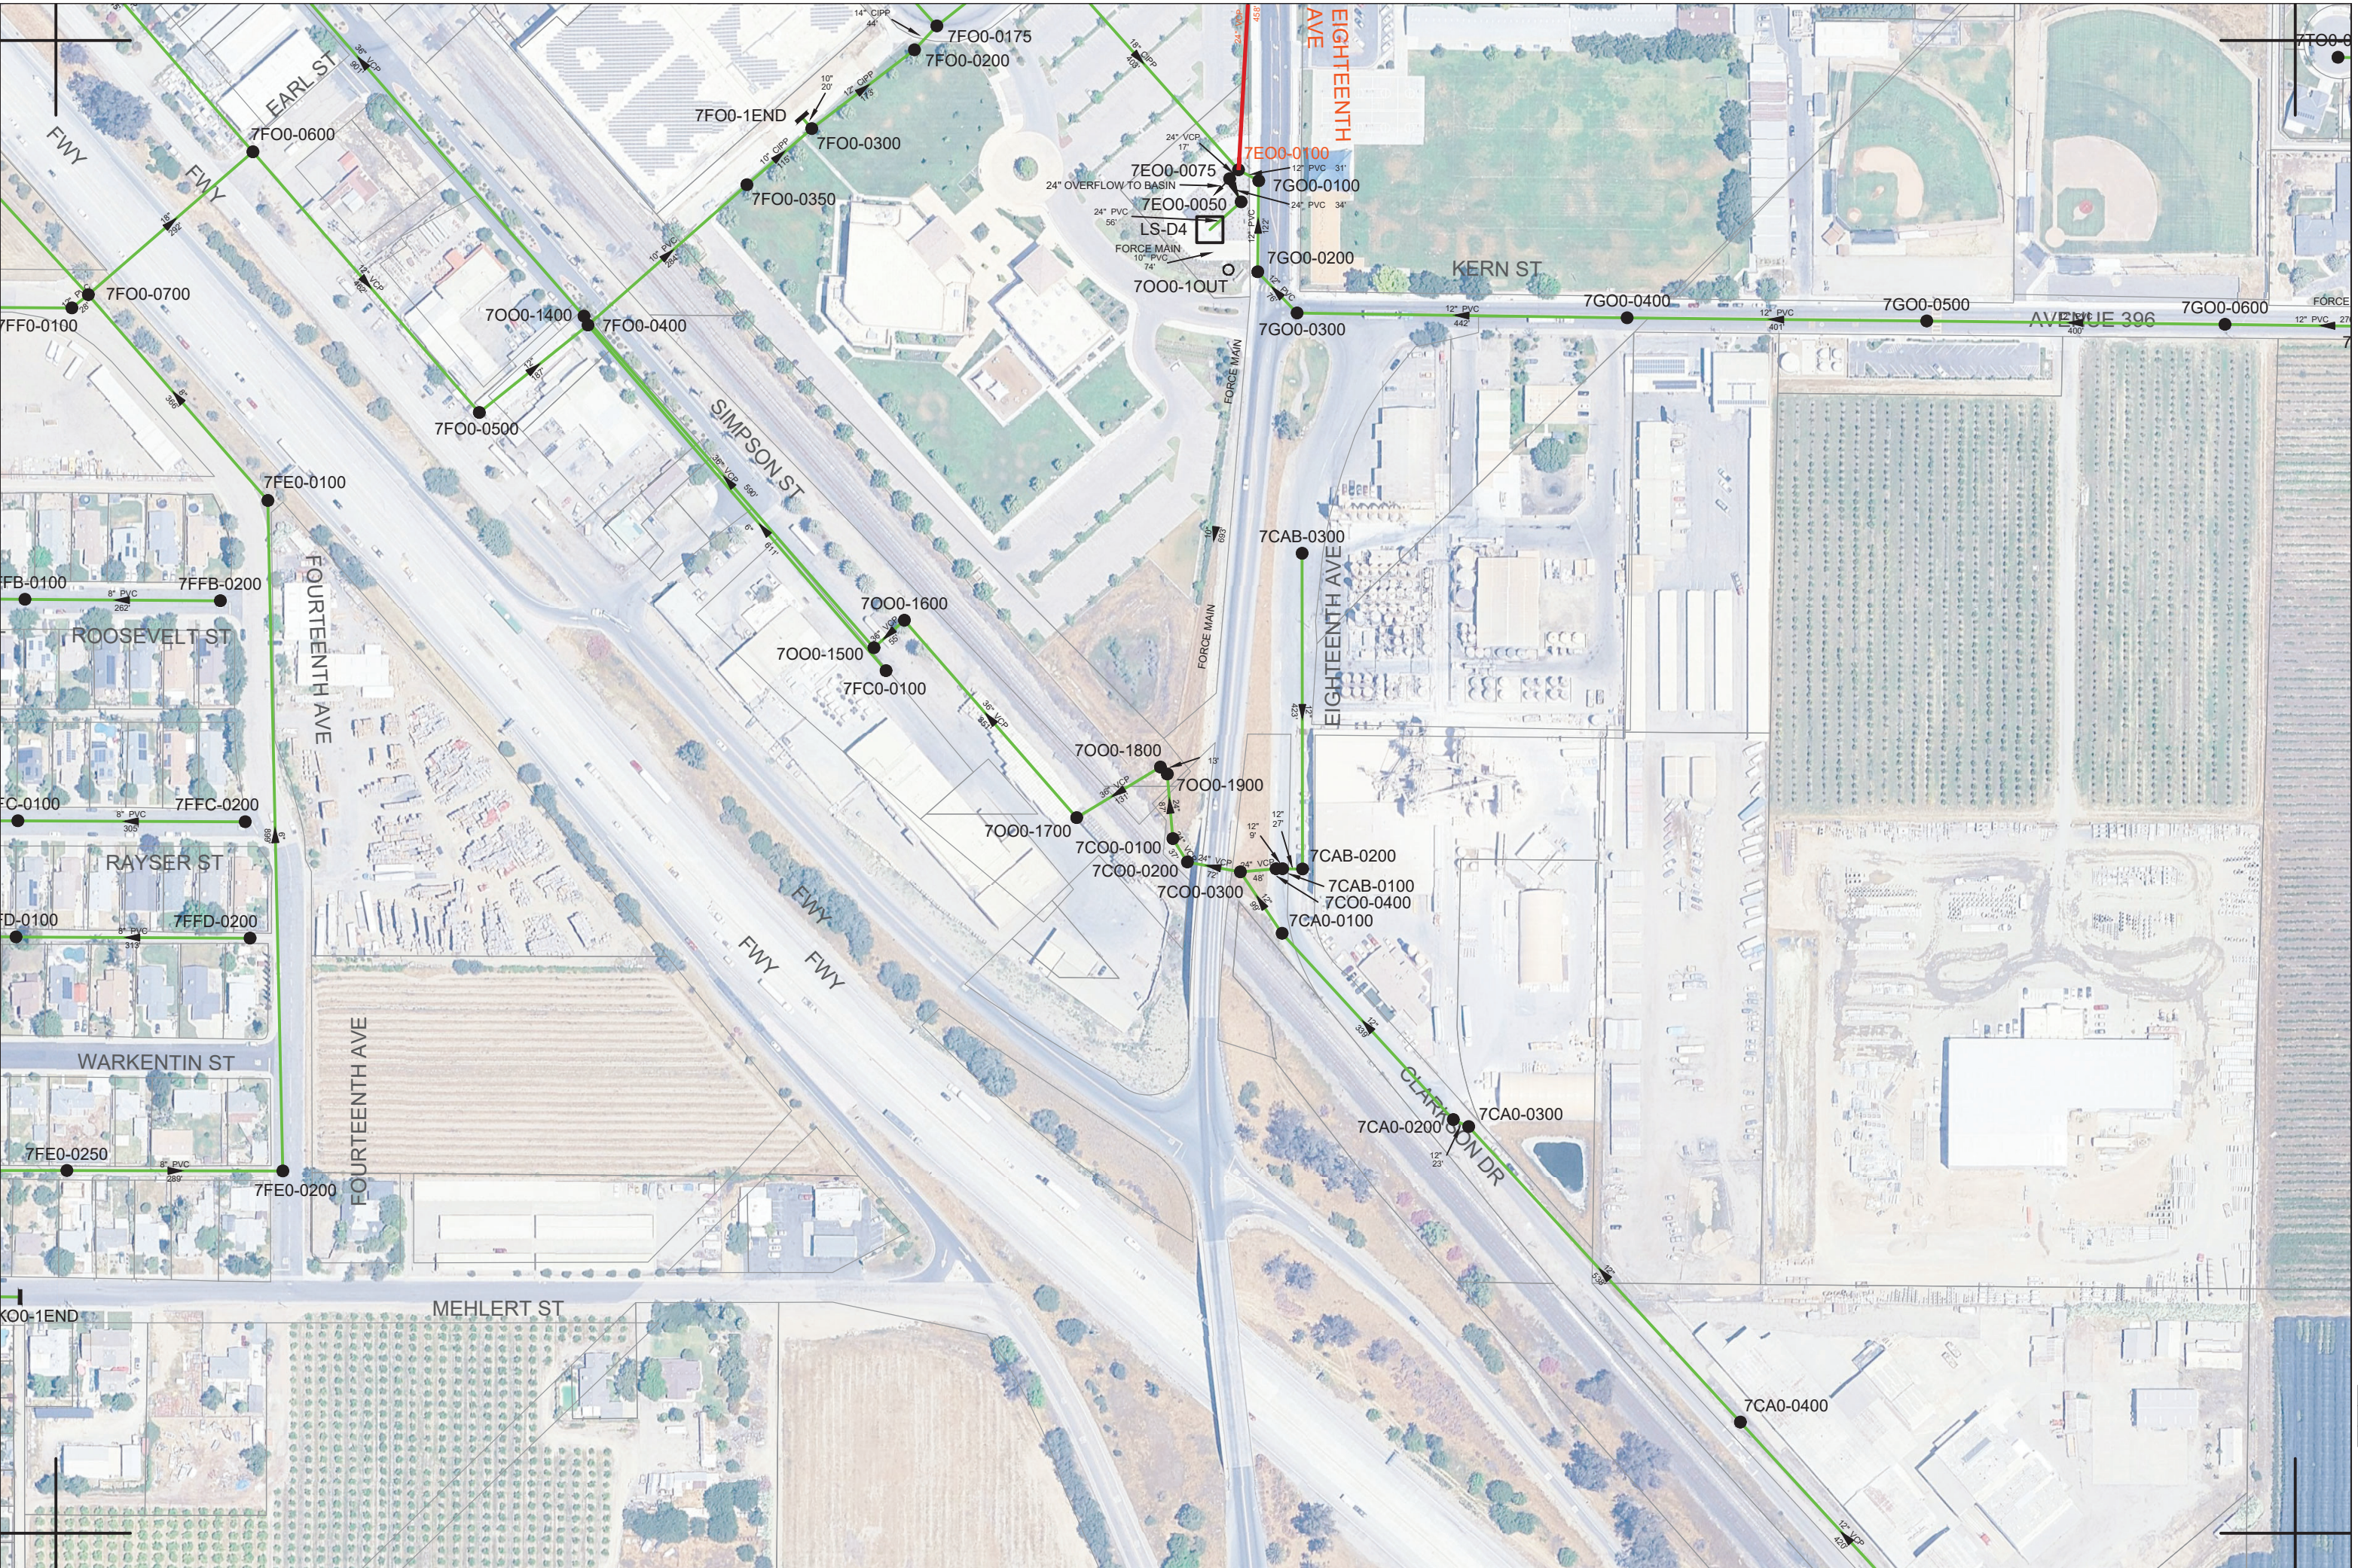

DATE PRINTED:
November 17, 2025



SELMA - KINGSBURG - FOWLER
COUNTY SANITATION DISTRICT



K37	K47	K56
K38	K48	K57
K39	K49	K58

K48